
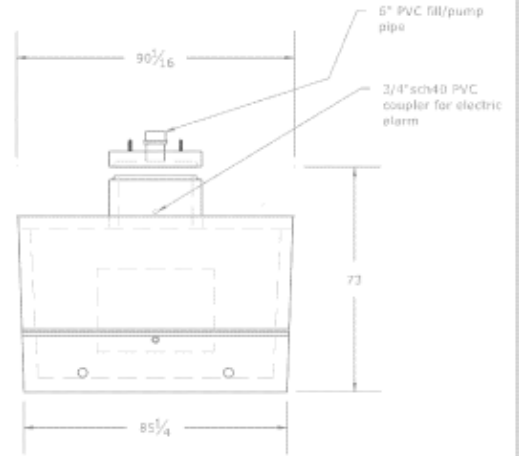
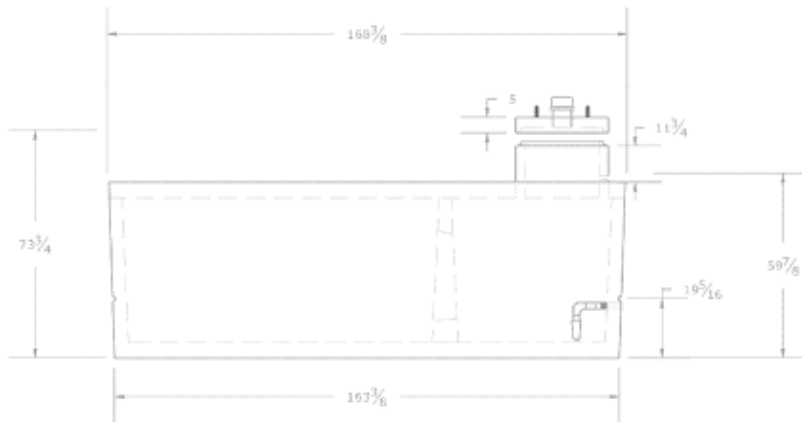




Product Name: 2000gal Cistern Date: October 31, 2011
 Working Capacity: 0,000, (2000gal) Model: 2000CISTN
 Assembled Weight: approximately 24,000 lbs
 Joints: rubber gasket stop is placed in place between lid and body

Bural Depth: Recommended max. burial depth
 of 1 meter over top of back lid area
 from exterior level. Extra
 reinforcement is available.
 Mix Design: Subgrade required. Concrete.
 Strength: 38-35Mpa @ 28 days Air Entrainments: 6-8 %
 Reinforcement:
 5-Bay/Bottom: 15m and 15m outer min. 12" spacing, 1" cover
 Top: 10m & 25m outer longitudinally max. 18" dia. 1" cover
 Pipe/Wall Connections:
 1) base: 1-1/4" NPT female coupler cast in pad
 1 PVC 3/4" coupler in riser

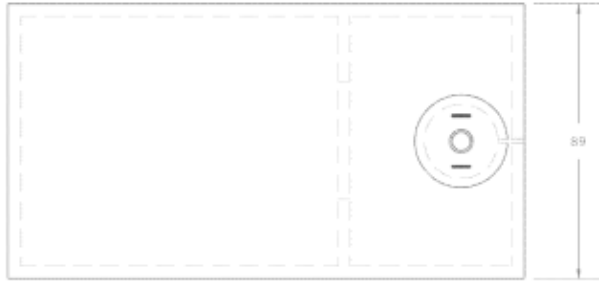


ONTARIO AGRA
 PIPING & SUPPLIES INC.

TITLE: 2000gal Cistern		SCALE: NTS	
SAVED AS: 2000gal cistern mm 2011.dwg	REVISION DATE: Oct. 31, 2011	DWG #: 2000c11-001	

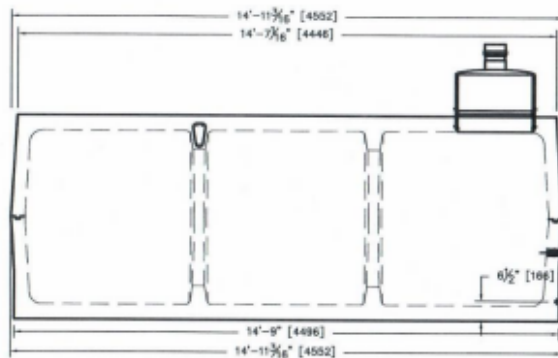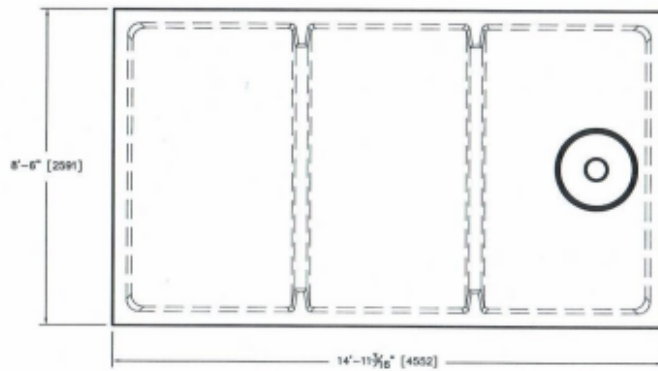



Product Name: 3000gal cistern **Date:** March 29, 2019
Working Capacity: 13,779L (3,031gal) **Model:** 30000CLP
Assembled Weight: 12,943Kg (28,536 lbs)
Joints: Sealant approved for potable water is normally applied at plant by Roswell Concrete Products Ltd. employee to create a watertight seal.
Burial Depth: Recommended max. burial depth of 1 metre over top of tank lid away from vehicular travel. Extra reinforcement is available.
Mix Design: Sulphate resistant concrete, **Strength:** 35Mpa @ 28 days min. **Air Entrainment:** 5-8 %
Reinforcement:
 Top 5": #6 rebar longitudinally, 1" cover,
 #4 rebar transversely, min. 1" cover
 Sides and Bottom: Polypropylene strand at 3kg/m3.
Pipe/Wall Connections: 1-1/4" sch40 PVC threaded fitting on lower end, 6" PVC pipe in riser lid
Model# of Other Tanks in Series:

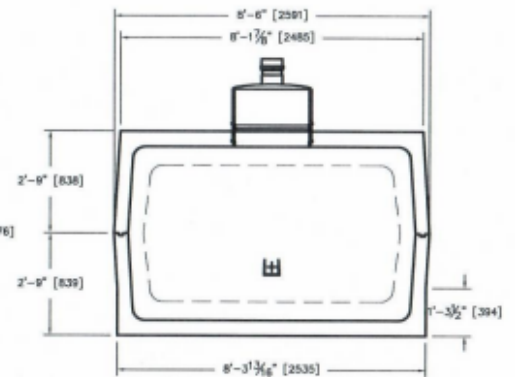


ONTARIO AGRA
 PIPING & SUPPLIES INC.

TITLE: 3000gal LP cistern		SCALE: NTS	
SAVED AS: 3000gal cistern 2019.dwg	REVISION DATE: 10/01/20	DWG #: 3000CLP-01	




Product Name: 4000gal cistern Date: March 12, 2010
 Working Capacity: 18,150L (4000gal) Model: 4000CT06
 Assembled Weight: 17,235Kg (18 tons)
 Joints: Sealant approved for potable water is normally applied on site by Roswell Concrete Products Ltd. employee to create a watertight seal.
 Burial Depth: Recommended max. burial depth of 1 metre over top of tank lid away from vehicular travel. Extra reinforcement is available.
 Mix Design: Sulphate resistant concrete.
 Strength: 30-35Mpa @ 28 days Air Entrainment: 4-6 %
 Reinforcement:
 Top/bottom: #6 rebar longitudinally 12"OC max. spacing, 1" cover,
 #4 rebar transversely 12"OC spacing, min. 1" cover
 Sides: #4 rebar max. 12" OC both ways, 1" cover min.
 Pipe/Wall Connections: 1-1/4" sch40 PVC threaded fitting on lower end,
 6" PVC pipe cast-in riser lid
 Model# of Other Tanks in Series:

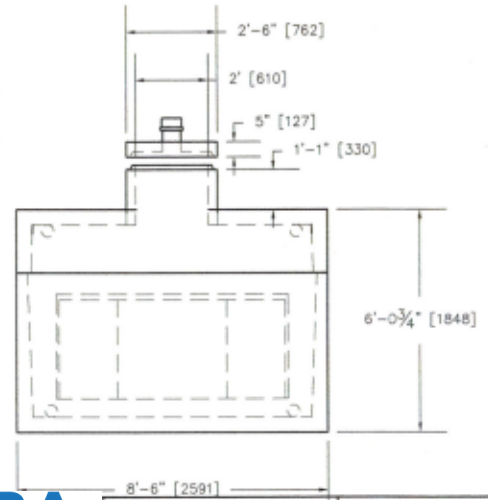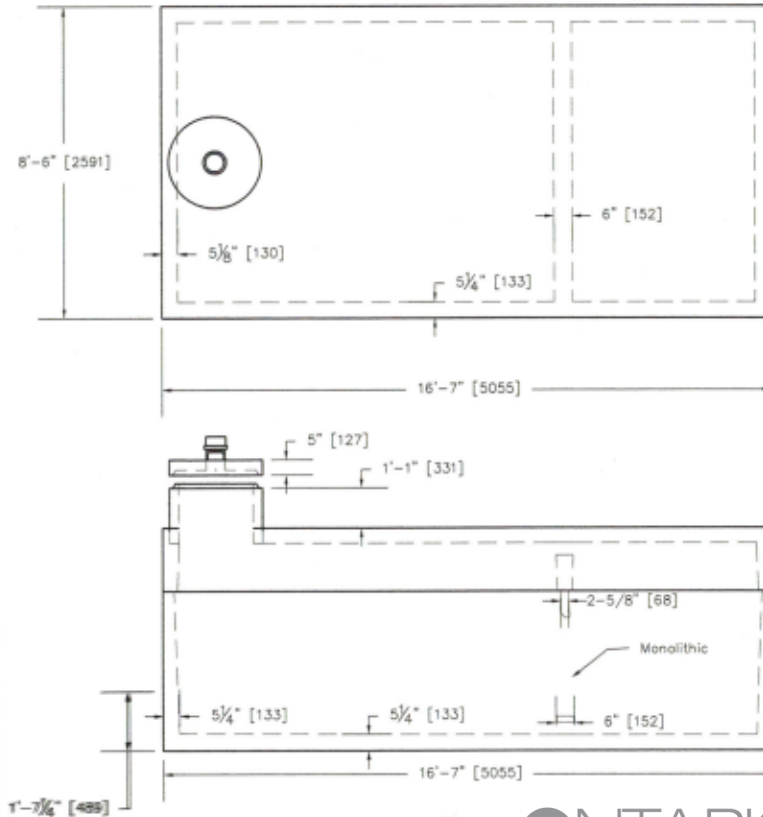

ONTARIO AGRA
 PIPING & SUPPLIES INC.

TITLE: 4000gal cistern		SCALE: NTS	
SAVED AS: 4000gal cistern.dwg	REVISION DATE: Mar 12/10	DWG # 4000HC10-002	

Product Name: 5000gal cistern Date: September 20, 2011
 Working Capacity: 22,700L (5000gal) Model: 50000CT06
 Assembled Weight:
 Joints: Sealant approved for potable water is normally applied on site by Roswell Concrete Products Ltd. employee to create a watertight seal.
 Burial Depth: Recommended max. burial depth of 1 metre over top of tank lid away from vehicular travel. Extra reinforcement is available.
 Mix Design: Sulphate resistant concrete, Strength: 30-35Mpa @ 28 days Air Entrainment: 4-6 %
 Reinforcement:
 Top/bottom: #6 rebar longitudinally 12"OC max. spacing, 1" cover, #4 rebar transversely 12"OC spacing, min. 1" cover
 Sides: #4 rebar max. 12" OC both ways, 1" cover min.
 Pipe/Wall Connections: 1-1/4" sch40 PVC threaded fitting on lower end, 6" PVC pipe cast-in riser lid
 Model# of Other Tanks in Series:

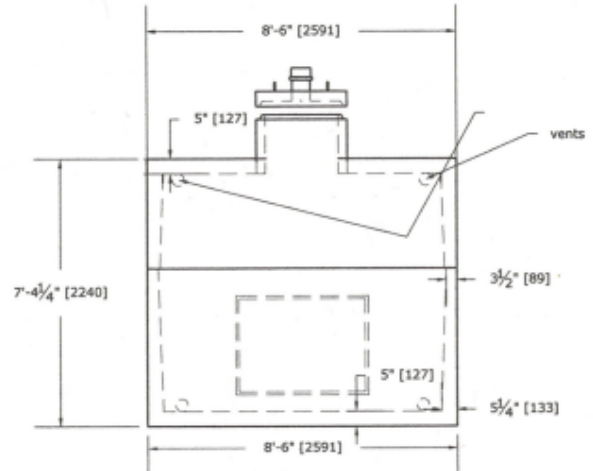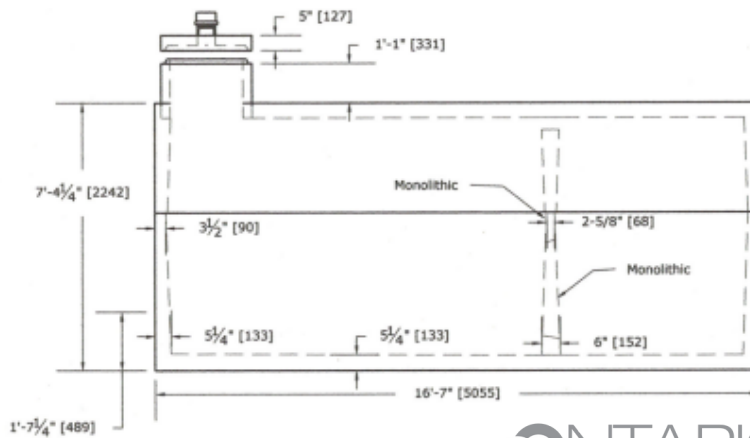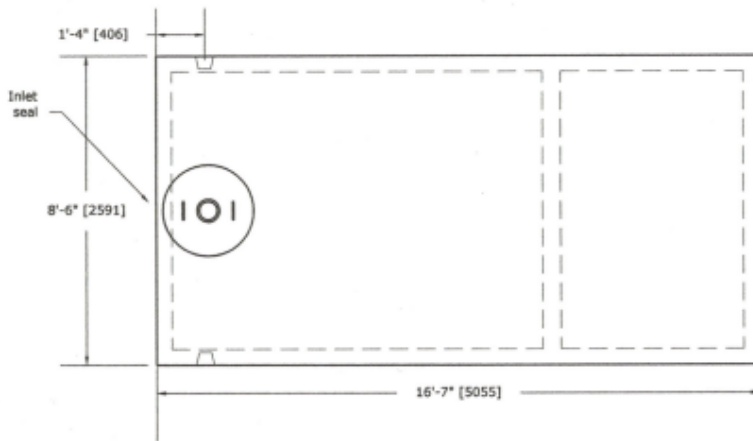

ONTARIO AGRA
 PIPING & SUPPLIES INC.

TITLE: 5000gal cistern		SCALE: NTS	
SAVED AS: 5000galcisternmm.dwg	REVISION DATE: Sept. 20/2011	DWG #: 5000HC10-002	

